

WaiWela PH28 & PH20 Domestic Hot Water Recirculation




Efficient Technology Sales, LLC
5350 Joliet Street #2
Denver, CO 80239
800-605-6542
www.waiwela.com



KEY

- Circulation Pump
- 3/4" Union
- Check Valve
- 3/4" Ball Valve
- Boiler Drain
- Pressure Relief Valve

This drawing is intended only as a guide and not as a replacement for professionally engineered project drawings. It does not imply compliance with local building codes. Installation may vary, depending on installation location, and must be done in accordance with all local building codes. Confer with local building officials before installation.

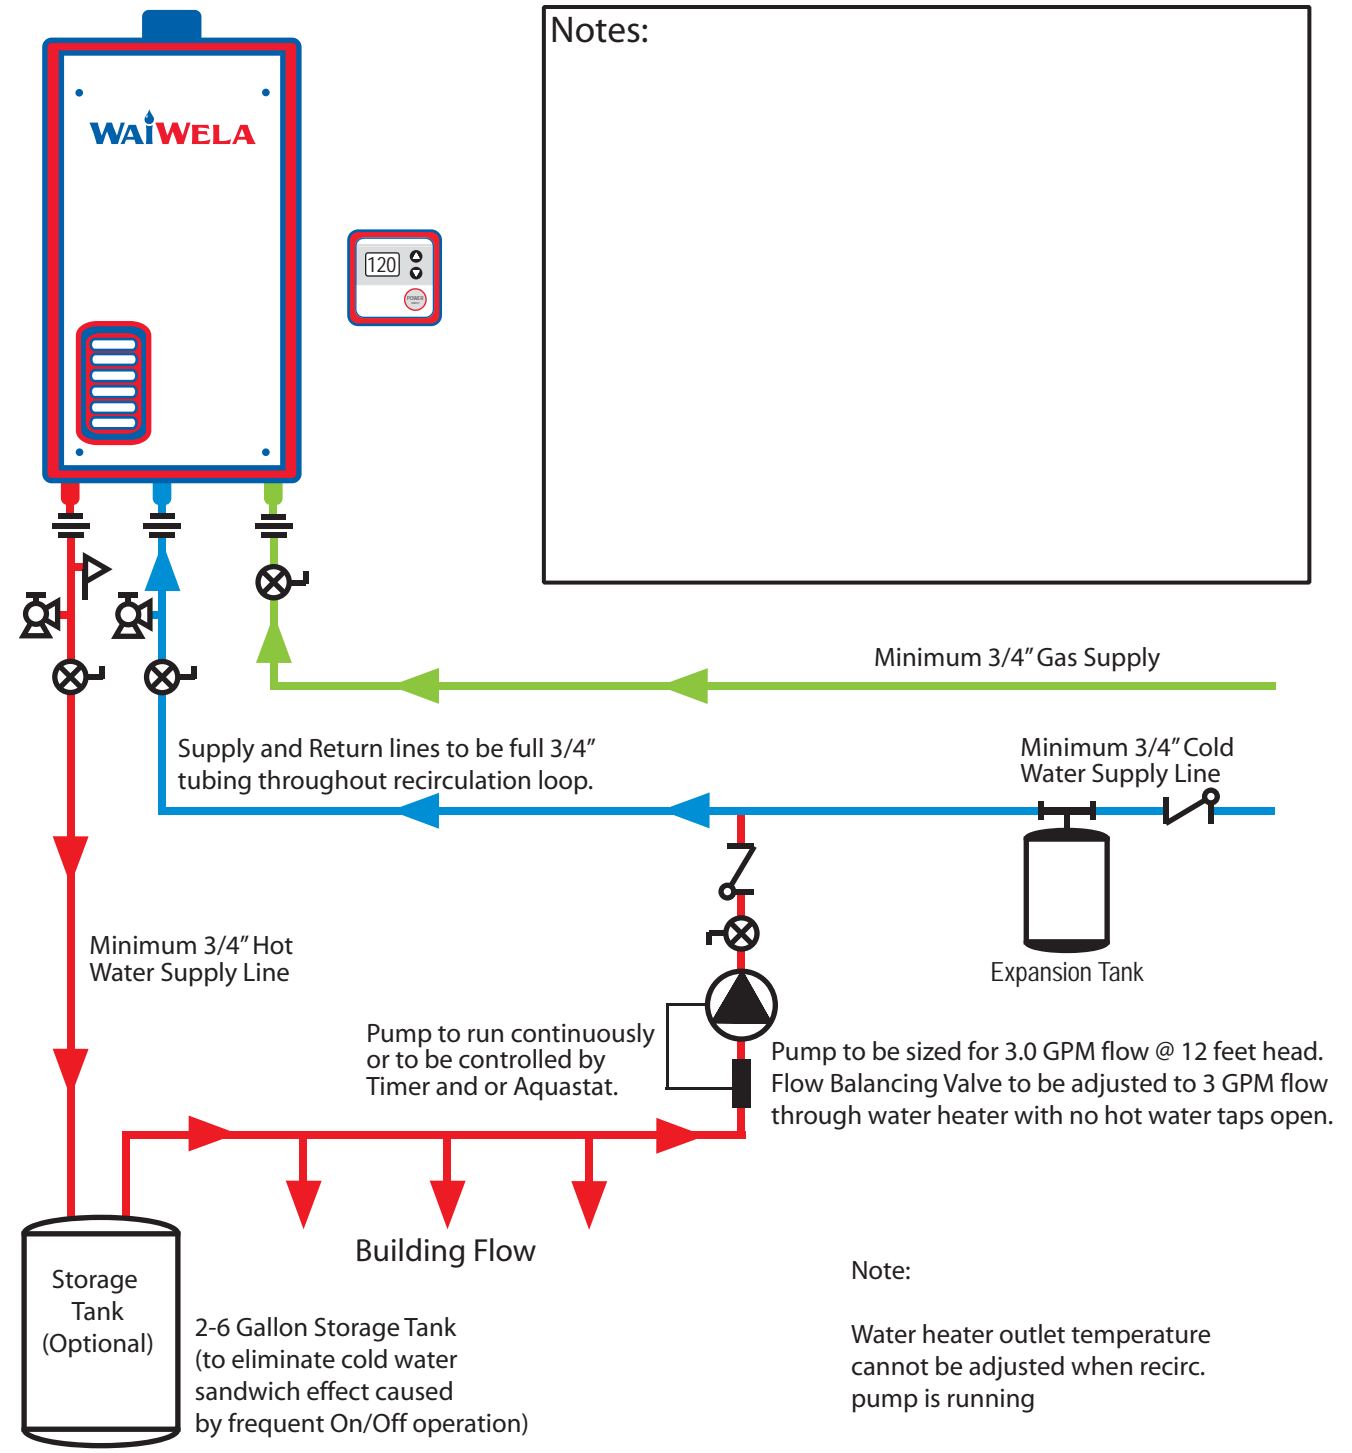

Notes:

Pump to run continuously or to be controlled by Timer and or Aquastat.
Pump to be sized for 3.0 GPM flow @ 12 feet head.
Flow Balancing Valve to be adjusted to 3 GPM flow through water heater with no hot water taps open.

Note:
Water heater outlet temperature cannot be adjusted when recirc. pump is running